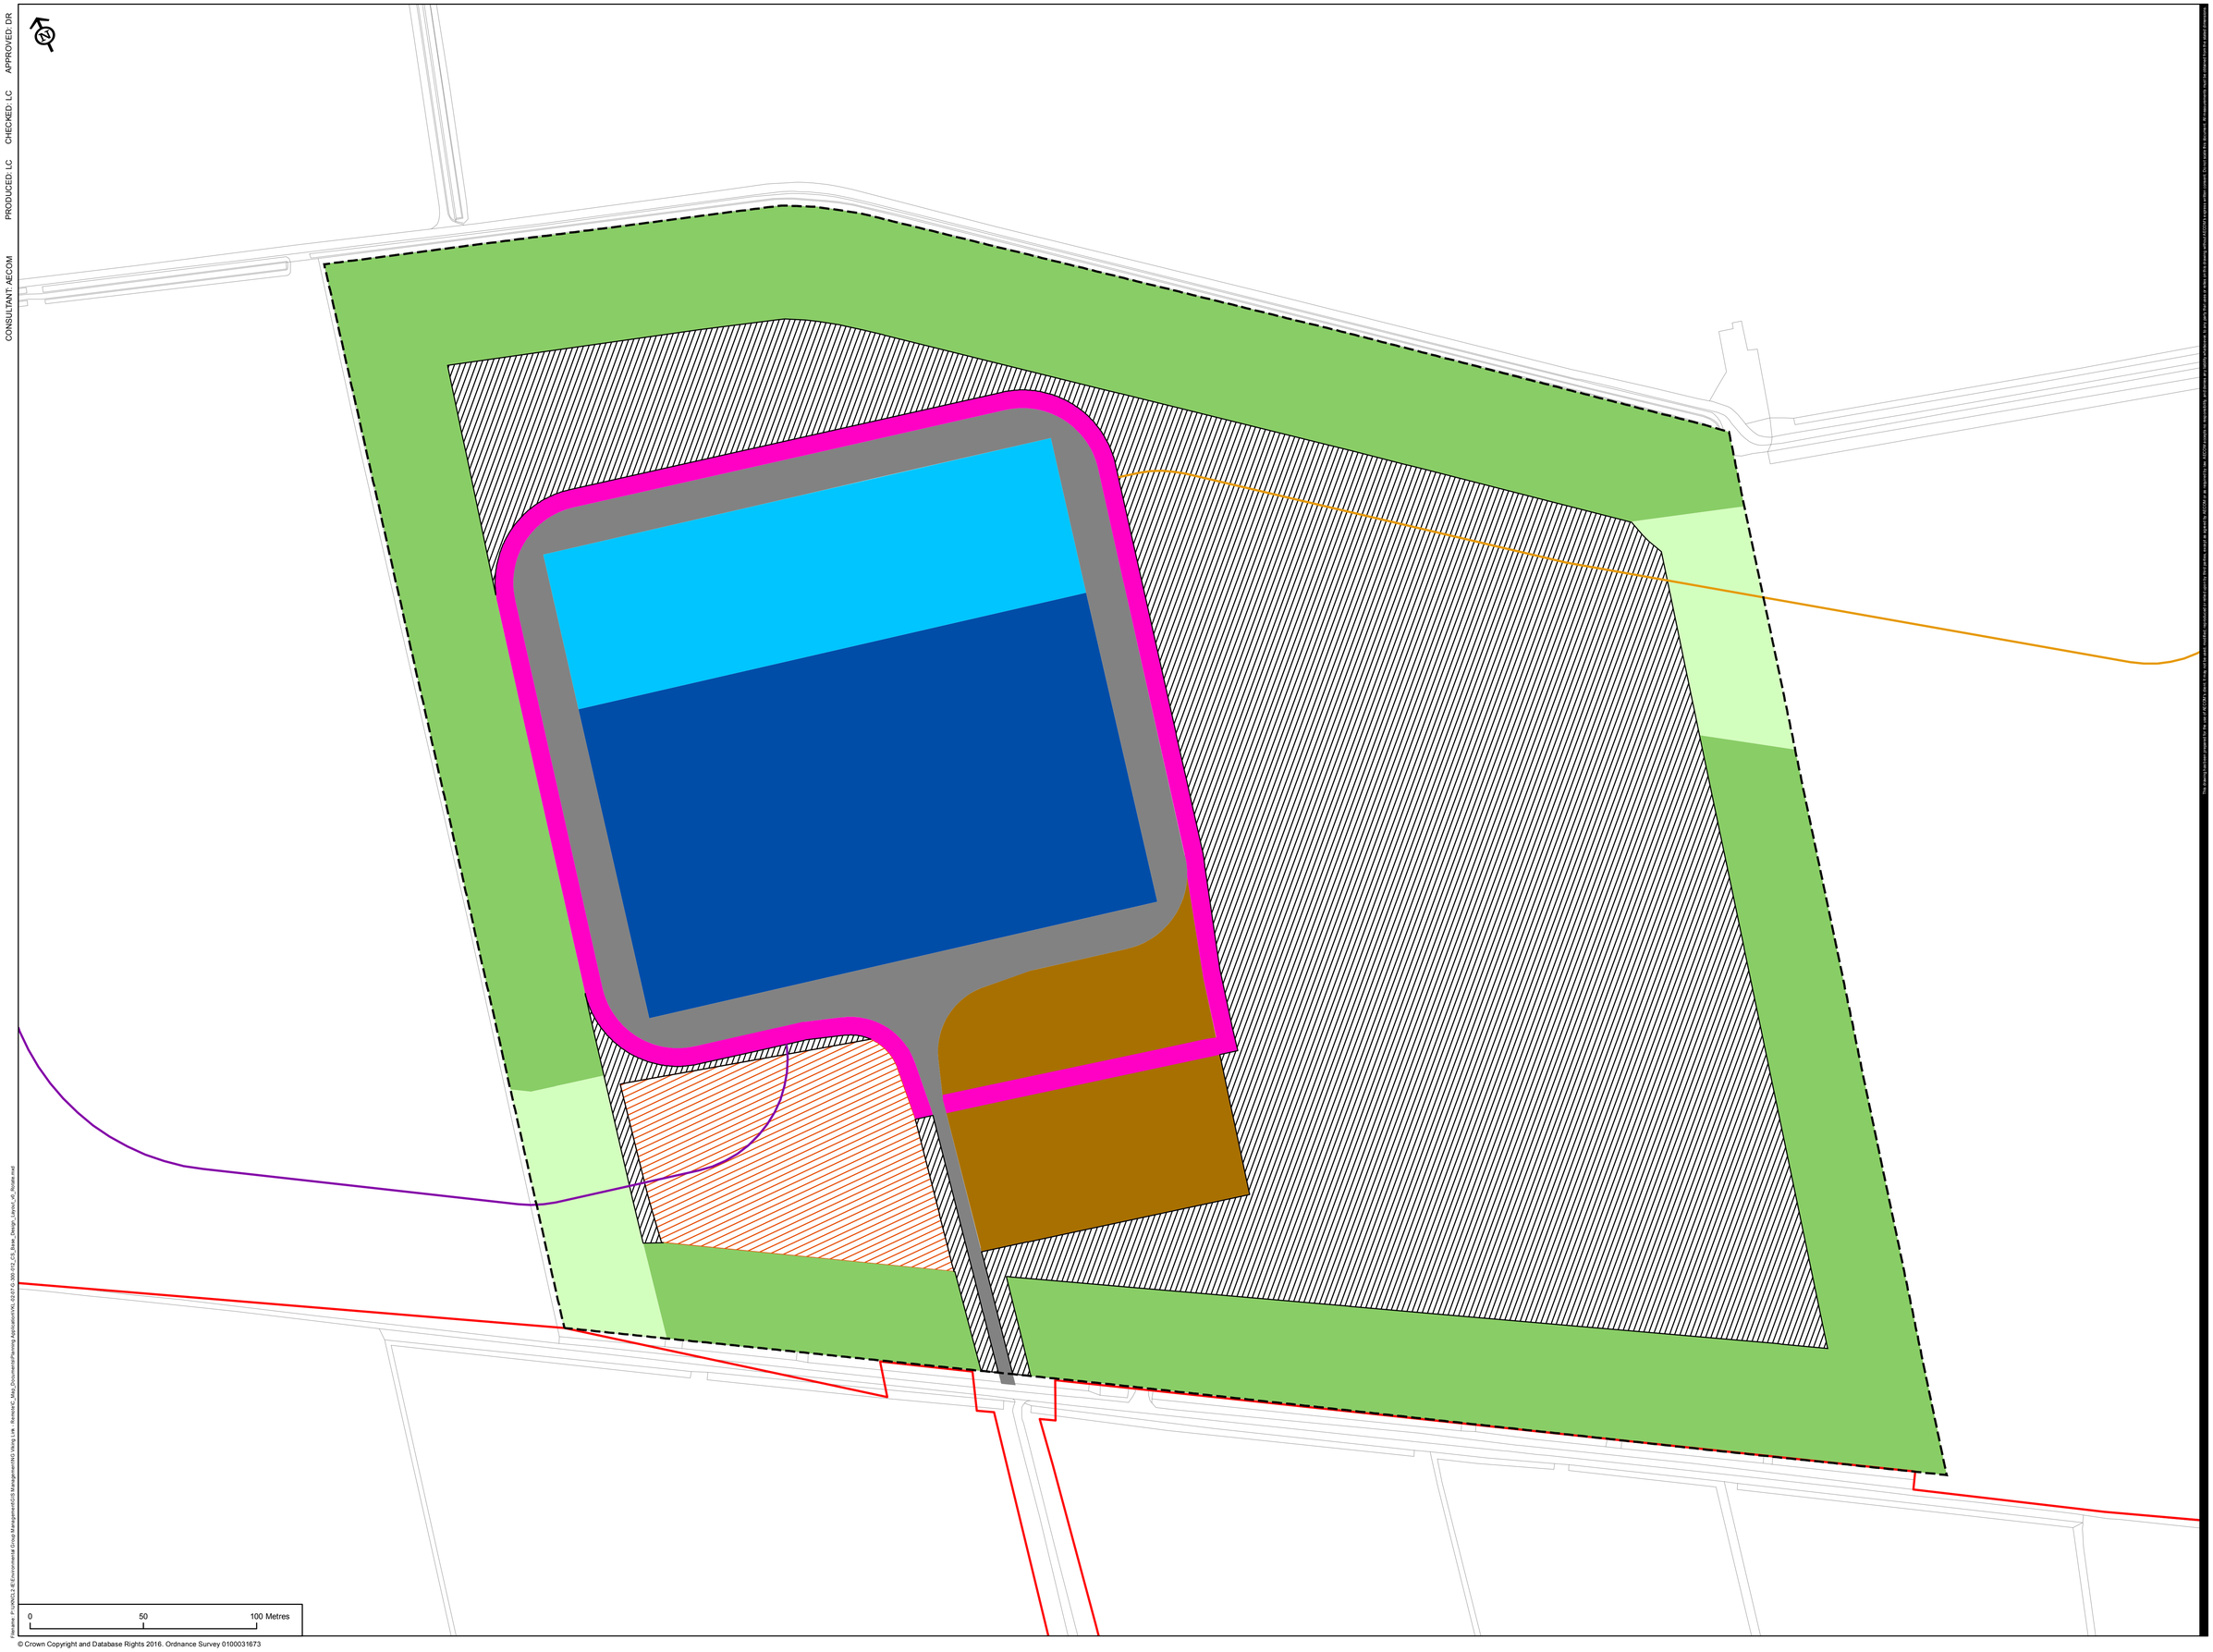


VikingLink

**LEGEND**

- Application Boundary
- Proposed Converter Station Site
- Indicative AC Cable Alignment
- Indicative DC Cable Alignment
- Buildings up to 16m and outdoor equipment up to 24m
- Buildings and outdoor equipment up to 24m
- Attenuation zone
- Reinstated zone
- Additional hardstanding zone
- Landscape planting zone
- Landscape planting zone - Cable entry and exit point
- Perimeter road zone
- Security zone

**REVISION:**

| REV. | DATE | DESCRIPTION |
|---|---|---|
| 00 | 22/08/17 | PLANNING ISSUE |

**FIGURE NO.**

VKL-02-07-G-300-012

**FIGURE TITLE**

PROPOSED CONVERTER STATION: OPERATIONAL PHASE PLAN

**SHEET NUMBER**

1 of 1

**NOTES**

| Date: | Scale at A1: |
|---|---|
| 22/08/17 | 1:1,250 |

APPROVED: DR
CHECKED: LC
PRODUCED: LC
CONSULTANT: AECOM

© Crown Copyright and Database Rights 2016. Ordnance Survey 0100031673